







10 kV voltage coated neutral line, in accordance with the rules of arrangement of electric devices 1.7.59 point, around the area where cathodic device is located for 0.8-1 meter and no less than 0.5m depth, closed circuit shall be arrayed, when shall be connected to grounding device and vertical electrode of grounding.

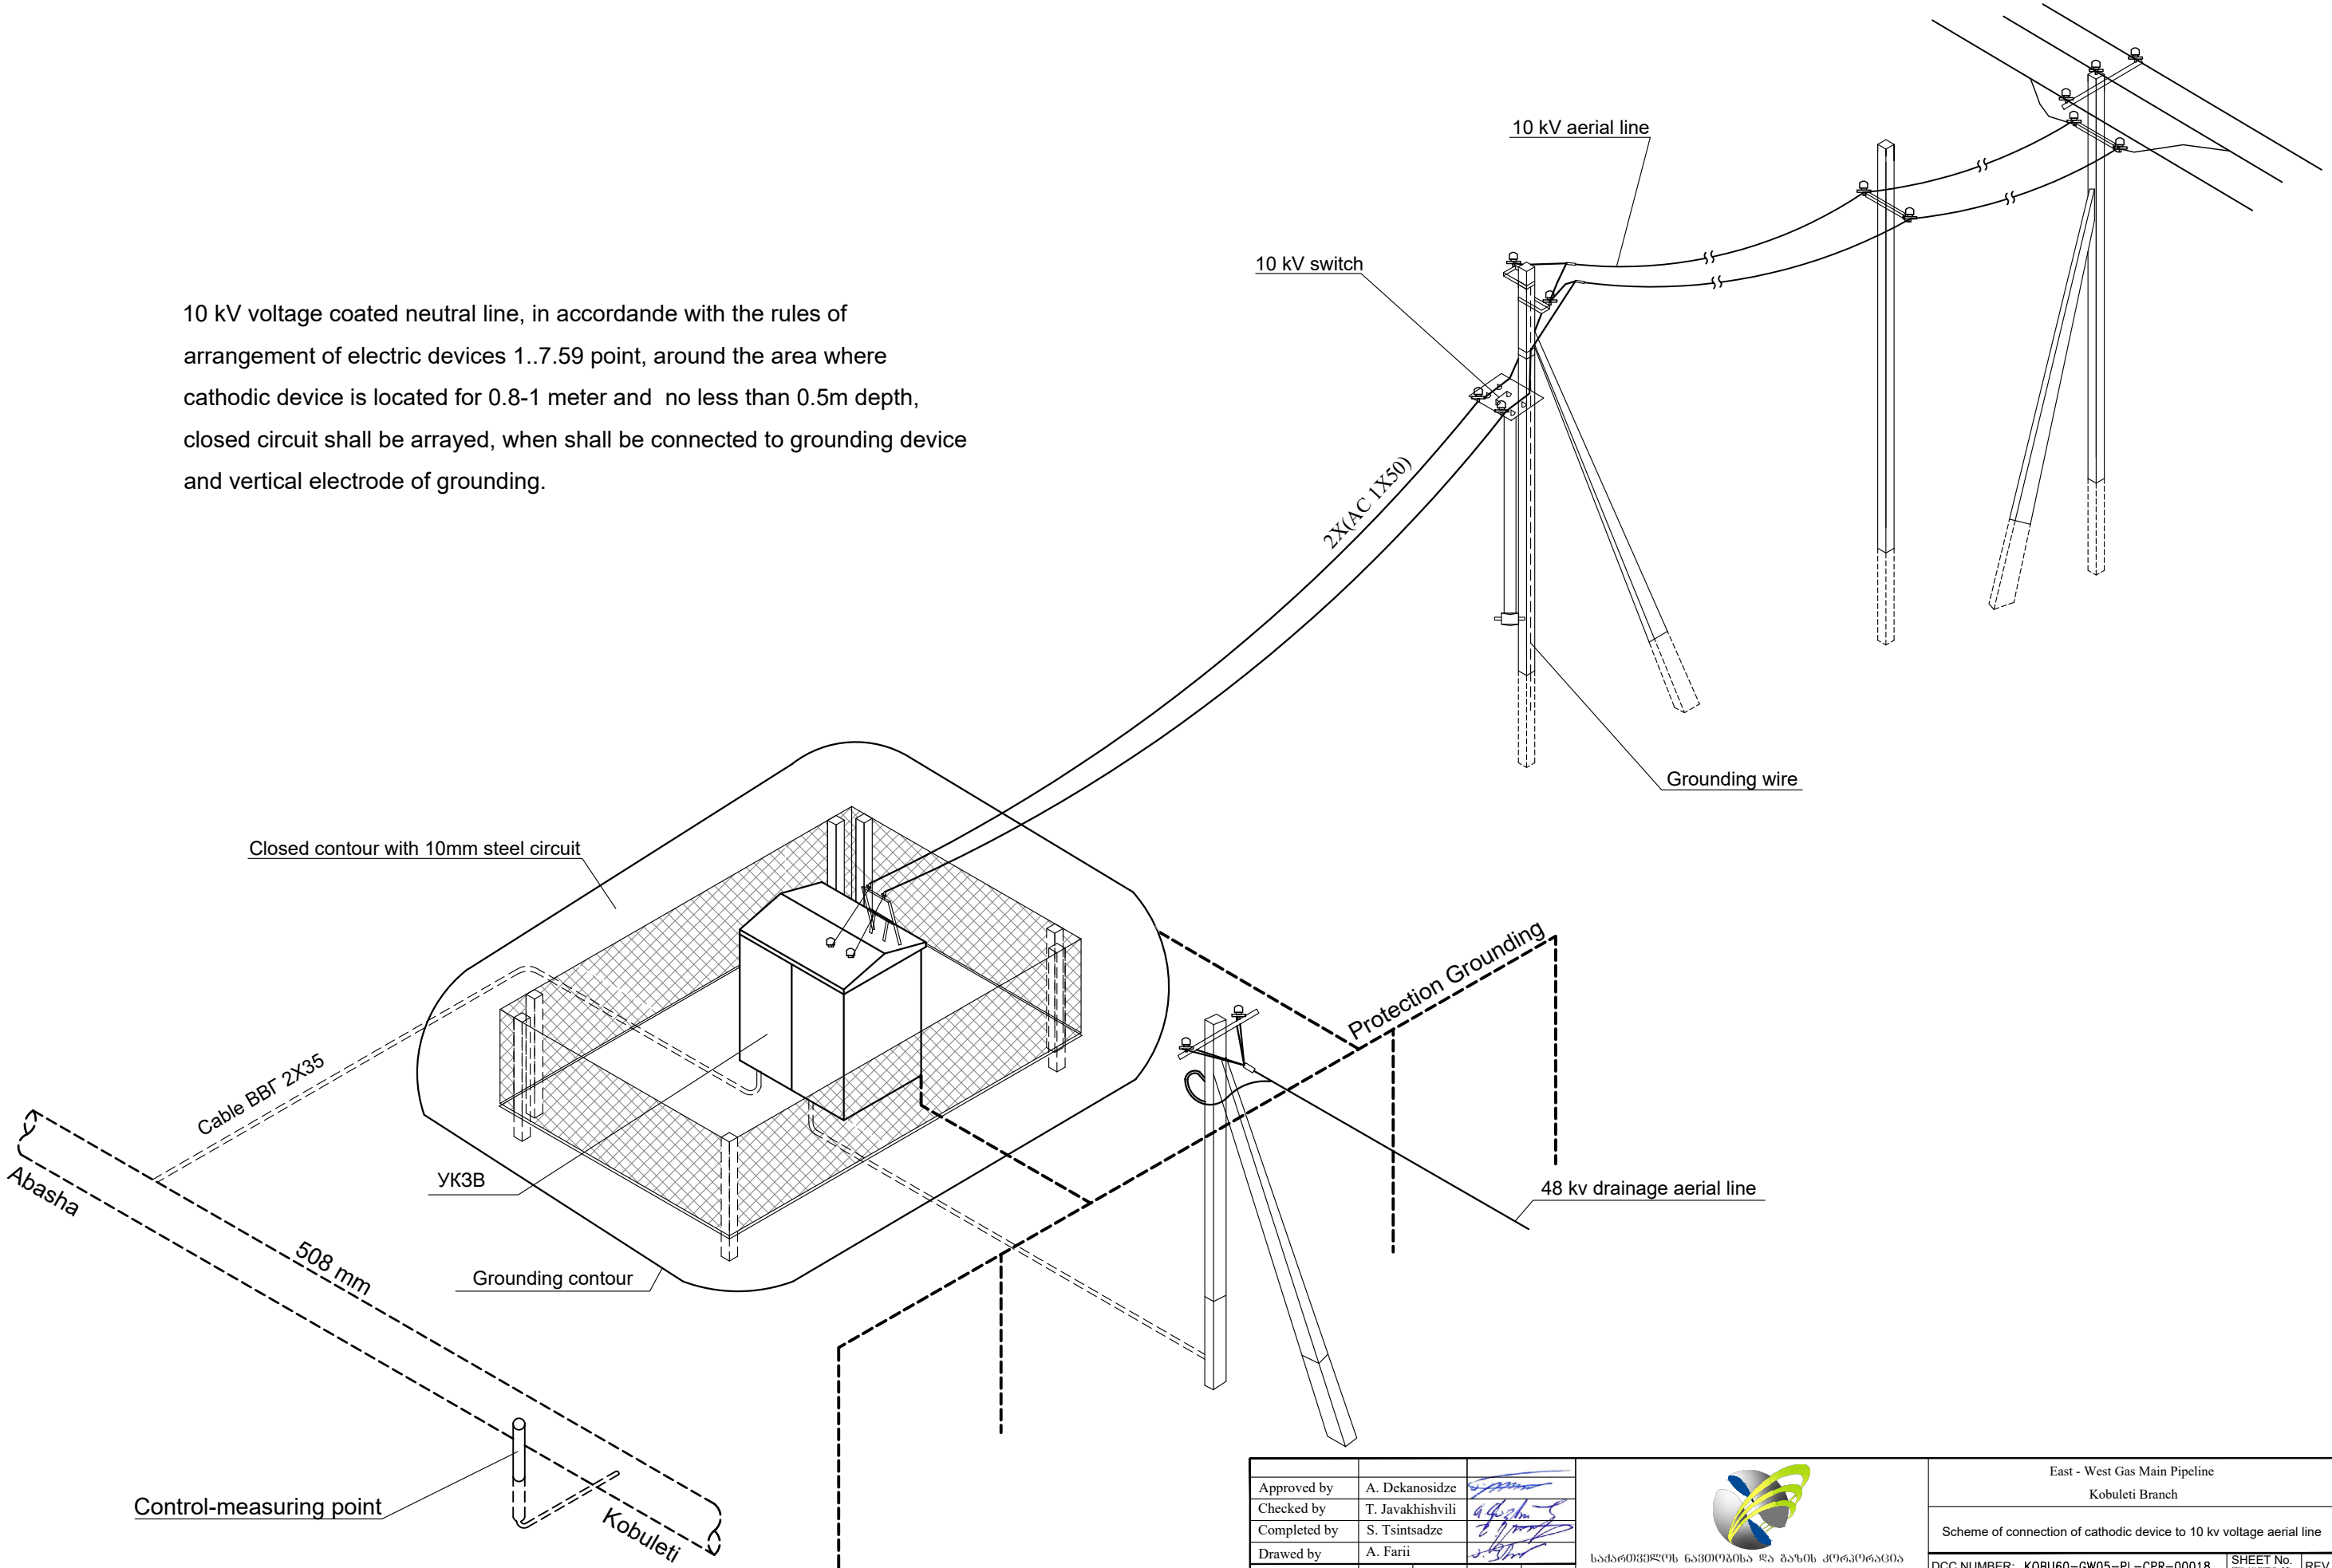

			 საქართველოს ნავთობისა და გაზის კორპორაცია Georgian Oil & Gas Corporation	East - West Gas Main Pipeline Kobuleti Branch		
Approved by	A. Dekanosidze			Scheme of connection of cathodic device to 10 kv voltage aerial line		
Checked by	T. Javakhishvili					
Completed by	S. Tsintsadze					
Drawn by	A. Farii					
REV.	C01			DCC NUMBER: K0BU60-GW05-PL-CPR-00018	SHEET No. 33603800 №	REV.
თარიღი/ DATE	30/05/16			SCALE:	No:	1(1) C01